


200 AMP MOBILE HOME SERVICE ENTRANCE REQUIREMENTS

POLE SPECIFICATIONS

1. 20 FOOT TREATED POLE; SIX INCHES IN DIAMETER.
2. POLE MUST BE SET TWO FEET OR CLOSER TO MOBILE HOME.
3. POLE MUST BE SET FOUR FEET DEEP IN GROUND.
4. MUST INSTALL CONCRETE AROUND TOP TWO FEET OF HOLE.
5. WEATHERHEAD AND EXPOSED SERVICE CONDUCTORS MUST BE LOCATED AT LEAST 3 FEET FROM DOOR OR WINDOW. THE METERBASE MUST BE LOCATED AT LEAST 3 FEET FROM HINGED SIDE OF DOOR.
6. IT IS THE CUSTOMER'S RESPONSIBILITY TO PROVIDE A SERVICE POLE OF ADEQUATE STRENGTH AND STABILITY TO WITHSTAND THE STRAIN IMPOSED BY THE UTILITY'S SERVICE DROP.

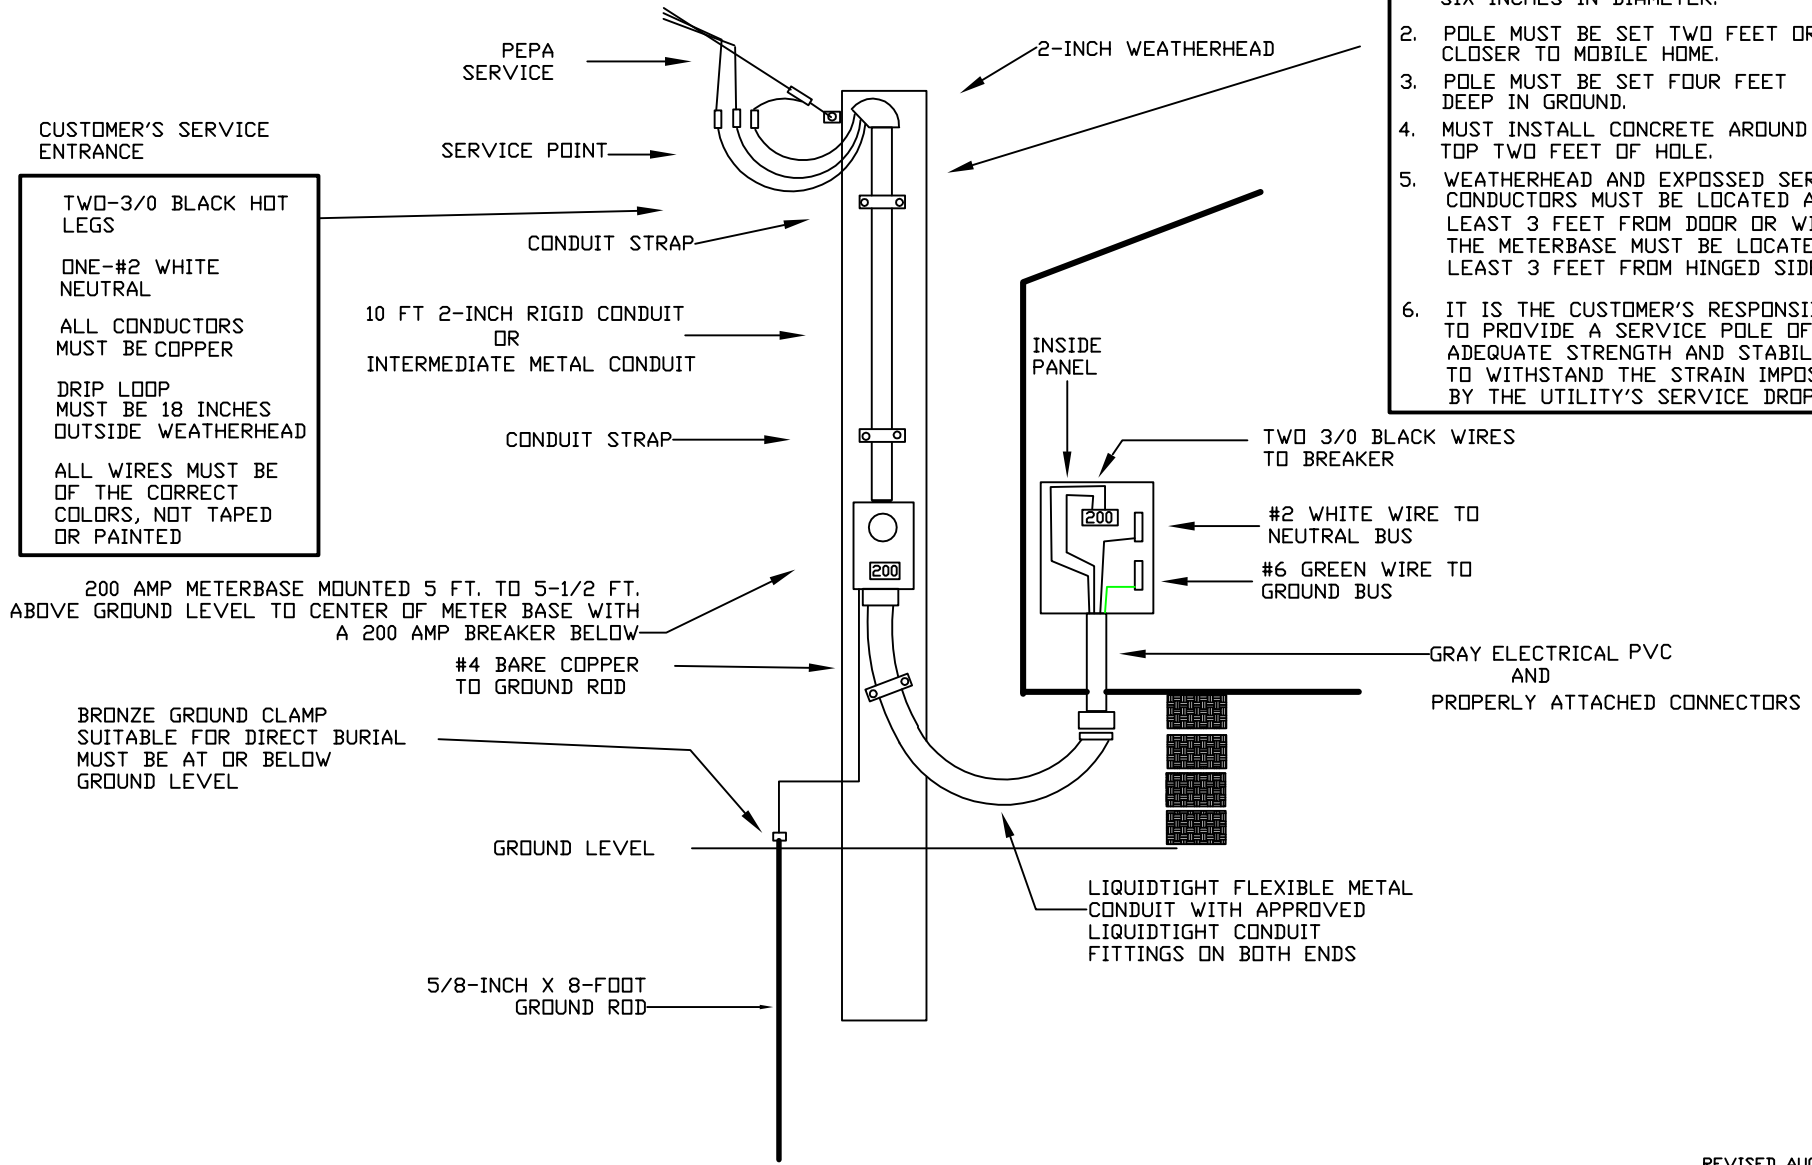

TWO-3/0 BLACK HOT LEGS
 ONE-#2 WHITE NEUTRAL
 ALL CONDUCTORS MUST BE COPPER
 DRIP LOOP MUST BE 18 INCHES OUTSIDE WEATHERHEAD
 ALL WIRES MUST BE OF THE CORRECT COLORS, NOT TAPED OR PAINTED

200 AMP METERBASE MOUNTED 5 FT. TO 5-1/2 FT. ABOVE GROUND LEVEL TO CENTER OF METER BASE WITH A 200 AMP BREAKER BELOW

BRONZE GROUND CLAMP SUITABLE FOR DIRECT BURIAL MUST BE AT OR BELOW GROUND LEVEL

ALL SERVICES SHALL MEET OR EXCEED THE NEC AND NESC CODES

SEE BACK FOR OTHER INSTRUCTIONS

REVISED AUGUST 2010
 PONTOTOC ELECTRIC POWER ASSOCIATION
 662-489-3211 PONTOTOC
 662-983-2727 BRUCE
 DRAWN BY R. MORGAN

IN ORDER TO INSURE THAT THE METER IS SET AT PROPER LOCATION, ALL DWELLINGS, APARTMENTS, MOBILE HOMES AND BUILDINGS MUST BE CLEARLY MARKED WITH THE CORRECT E-911 ADDRESS IN A PROMINENT LOCATION BEFORE A METER WILL BE SET.

APARTMENTS THAT ARE DESIGNATED BY APARTMENT NUMBER AND MOBILE HOME PARKS THAT ARE IDENTIFIED BY LOT NUMBER MUST ALSO BE CLEARLY MARKED. THE CORRECT APARTMENT NUMBER OR MOBILE HOME LOT NUMBER MUST BE SHOWN ON THE RENTAL RECEIPT.